

## Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
02.04.2026	Kanyakumari	Dinakaran	In Manavalakurichi, a sudden burst occurred in a drinking water pipeline joint, causing flooding on the road.



**400mm MS pipe damaged on 01.04.2026 was rectified and water supply effected on 02.04.2026 under 79 coastal CWSS in Kanyakumari district**

## Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
03.04.2026	Madurai	Dinamalar	Water leakage from a damaged pipeline on the Usilampatti–Vathalagundu road near Uttappanayakanur has led to accumulation in roadside ditches, causing obstruction to traffic



300mm DI pipe line leak was rectified on **04.04.2026** under **CWSS to 867 rural habitations in Madurai District** .

## Action taken on the Water supply issues reported


Date	District	Name of the Newspaper	Issues published
04.04.2026	Dindigul	Malaimalar	Cauvery water is being wasted due to a damaged pipe.



600mm PSC pipe line leak on 04.04.2026 was rectified and water supply effected on 05.04.2026 under **Vedasandur CWSS in Dindigul district**

## Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
04.04.2026	Thiruvarur	Dinakaran	A drinking water pipe has burst and 1,000 litres of water wasted near Muthupet

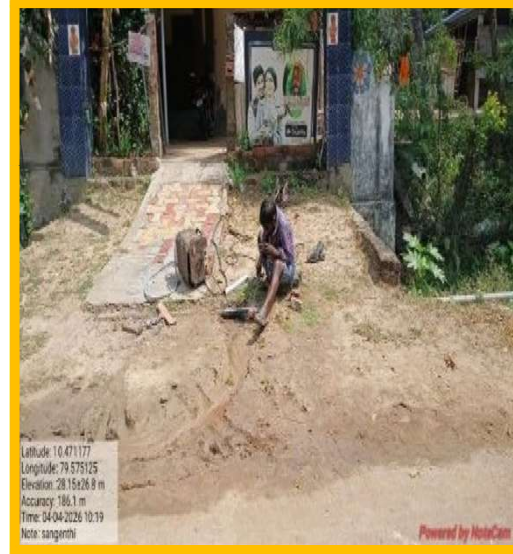

90mm MS pipeline leak was rectified and water supply effected on 04.04.2026 under Vedaranyam CWSS in Thiruvarur district

# Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
04.04.2026	Kallakuruchi	Dinamalar	A drinking water pipe has burst, causing water to flow on to the road



250mm AC pipe damaged was rectified and water supply effected on 04.04.2026 under CWSS to Kallakurichi and 23 others Habs in Kallakurichi Dt

## Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
07.04.2026	Karur	Dinakaran	At Thogaimalai, the Cauvery drinking water pipe is damaged and water is being wasted



50mm GI pipe damaged on 06.04.2026 was rectified and water supply effected on 07.04.2026 under CWSS to Manaparai Municipality & 2 way side habitations in Trichy district and 48 other habitations in Karur district.

## Action taken on the Water supply issues reported


Date	District	Name of the Newspaper	Issues published
09.04.2026	Tiruppur	Dinamalar	A pipe has burst in a trench dug for cable laying, leading to wastage of drinking water.



**350mm DI pipe damaged on 09.04.2026 was rectified and water supply effected on 10.04.2026 under CWSS to 165 rural habitations in 10 village panchayats of Tiruppur district**

## Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
15.04.2026	Krishnagiri	Dinamalar	Pipeline damage, drinking water is being wasted near Branch library in Bargur TP

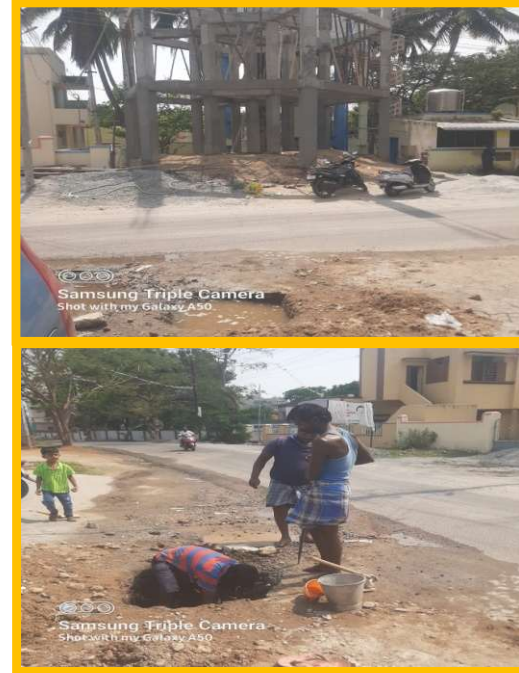

**200mm AC pipe line leak was rectified on 17.04.2026 under CWSS to Bargur TP and 25 other habitations**

## Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
16.04.2026	Coimbatore	Dinathanthi	Broken drinking water pipeline flowing like a stream near Kinathukadavu.



**600mm DI pipe line leak was rectified and water supply effected on 16.04.2026 under CWSS to Kurichi, Kuniamuthur in Coimbatore corporation and Kinathukadavu T.P. in Coimbatore District**

## Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
18.04.2026	Theni	Dinakaran	Drinking water is being wasted due to a damaged pipe.



**350mm PSC pipe line leak was rectified under C.Pudupatty CWSS in Theni district**

## Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
24.04.2026	Dindigul	Dinamalar	Drinking water is being wasted as it sprays onto the road due to a pipe fault.



**150mm GI pipe line leak was rectified on 24.04.2026 under RAMNAD CWSS ( Package -V) in Dindigul district**

## Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
27.04.2026	COIMBATORE	Dinamalar	Railway flyover work is only 25 percent complete due to delays in replacing drinking water pipes



700 mm MS pipeline laying work is in progress under **CWSS to CLPRA.**

## Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
28.04.2026	KRISHNAGIRI	Dinakaran & Kalaikathir	A pipeline break has occurred in the Hogenakkal Drinking Water Project.



200mm DI - Sluce valve leak was rectified on 28.04.2026 under **Hogenakkal Water Supply and Fluorosis Mitigation Project** in Krishnagiri district

## Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
29.04.2026	KRISHNAGIRI	Dinakaran & Kalaikathir	Drinking water is being wasted due to a pipe burst



**700mm MS pipe line leak was rectified on 29.04.2026 under Hogenakkal Water Supply and Fluorosis Mitigation Project in Krishnagiri district**

## Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
29.04.2026	Nagapattinam	Dinamani	Drinking water pipe broken; Drinking water wasting for a week



**தினமணி**

4/12



---

**குடிநீர் குழாய் உடைப்பு; ஒரு வாரமாக வீணாகும் குடிநீர்**

திருக்குவளை, ஏப். 29: கிழவோரை-கச்சனம் சாலை பட்டமங்கலத்தில் தெற்கு நிம்மேலி செல்லும் சாலை அருகே குடிநீர் குழாய் உடைந்து ஒரு வாரமாக பல்லாயிரக்கணக்கான லிட்டர் குடிநீர் வீணாகி வருகிறது.

கிழவோரை-கச்சனம் பிரதான சாலையோரத்தில் பதிக்கப்பட்டிருந்த குடிநீர் விநியோக குழாய் உடைந்ததால் தொடர்ந்து தண்ணீர் வெளியேறி சாலையில் தேங்கி ஓடுகிறது. இதனால், அப்பகுதியில் செல்லும் வாகன ஓட்டிகள் மற்றும் பாதசாரிகள் சிரமப்படுகின்றனர். மேலும், குடிநீர் வீணாகி சாலையில் தேங்குவதால் சாலை சேதமடையும் சூழல் உள்ளது. இதுகுறித்து அப்பகுதி மக்கள் பலமுறை சம்பந்தப்



பட்ட-துறை அதிகாரிகளிடம்புகார் அளித்தும் இதுவரை எந்த பயனும் இல்லை.

தற்போது கோடை காலம் என்பதால் பல்வேறு இடங்களில் குடிநீர் பற்றாக்குறை நிலவும் சூழலில் இவ்வாறு தண்ணீர் வீணாகுவது வேதனை அளிக்கிறது. எனவே, உடனடியாக சம்பந்தப்பட்ட அதிகாரிகள் நடவடிக்கை எடுத்து, உடைந்த குடிநீர் குழாயை சரிசெய்து தண்ணீர் வீணாவதை தடுக்க வேண்டும்.



**700mm DI pipe line leak rectification work was completed ,under Nagapattinam CWSS in Nagapattinam district**

## Action taken on the Water supply issues reported



Date	District	Name of the Newspaper	Issues published
30.04.2026	Thiruvarur	Dinakaran	Ovarur Vellankaal area water supply problem



**600mm MS pipe line leak was rectified on 27.04.2026 under Vedaranyam CWSS in Thiruvarur district**

## Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
30.04.2026	TENKASI	Dinamalar	Water supply 'cut' for 15 days. People of Alangulam Area are in severe distress

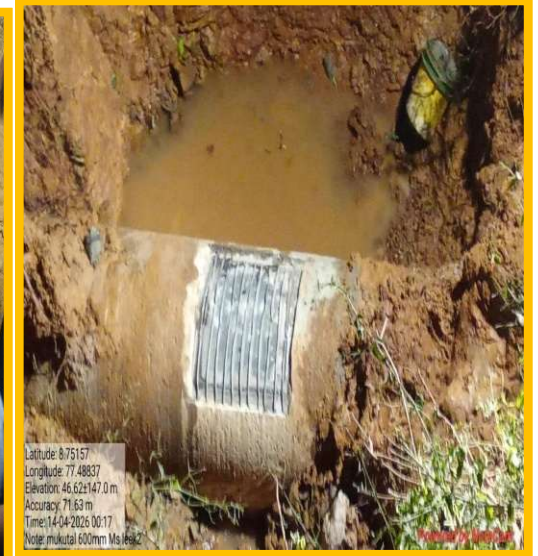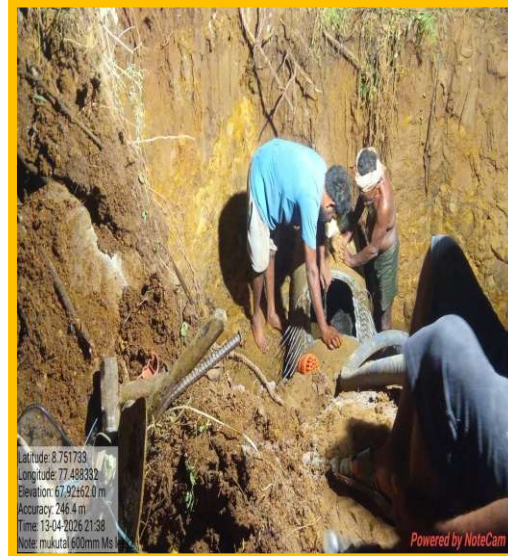

**700 mm BWSC pipeline leak works attended on 14.04.2026 and 22.04.2026 work was rectified and water supply effected on 30.04.2026 under Sankarankoil - Alangulam CWSS in Tirunelveli and Tenkasi District**