


Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
01.05.2026	DINDIGUL	Dinamalar	Near Velliyantai Bus Stop Water pipe broke and water is being wasted

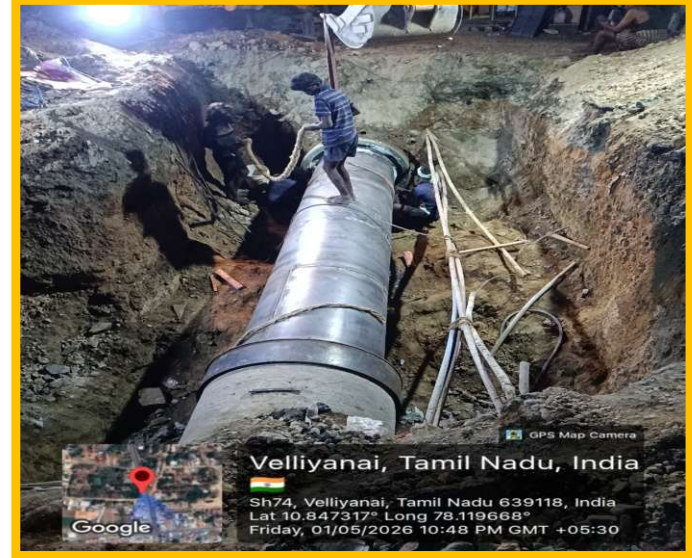

900 mm PSC pipeline leak works attended and rectified and water supply effected on 02.05.2026 under Dindigul CWSS in **Dindigul District**

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
01.05.2026	ERODE	Dinakaran	No water supply due to a break in the main pipe



300 mm MS pipeline & 250mm PSC pipe leak was attended and water supply effected on 30.04.2026 under CWSS to Chennai in Erode district

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
01.05.2026	VELLORE	Dinamalar	Water pipeline leak in Vellore fort road



600 mm DI pipeline leak was attended and water supply effected on 02.05.2026 under Vellore CWSS in Vellore district

Action taken on the Water supply issues reported



Date	District	Name of the Newspaper	Issues published
02.05.2026	Thiruvannamalai	Dinamalar	Combined water supply scheme pipe damaged



75 mm PVC pipeline leak was attended and water supply effected on 03.05.2026 under Keelpennathur CWSS in Thiruvannamalai district

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
05.05.2026	DINDIGUL	Dinakaran	Damaged pipeline causing leakage near Eriyodu

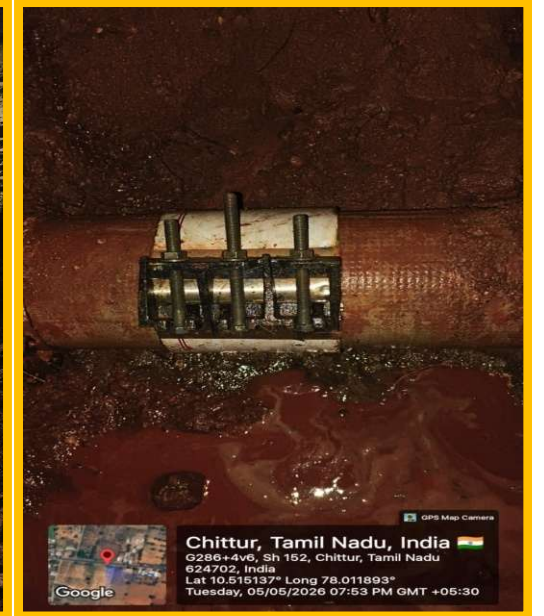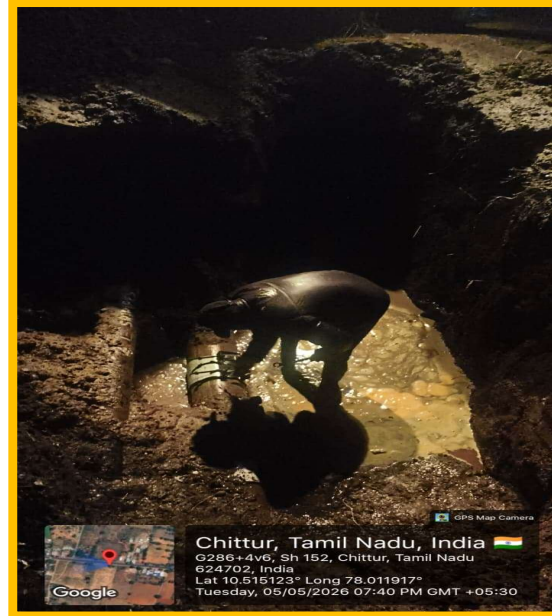

250 mm AC pipeline leak was attended and water supply effected on 06.05.2026 under **Dindigul CWSS in Dindigul district**

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
06.05.2026	KRISHNAGIRI	Kalaikathir	People are protesting with empty bottles, demanding drinking water



In Appukottai habitation of Vilangudi Panchayat, Illegal connections in 110 mm HDPE pipe had been removed by TWAD officials along with Local body Administration , under **Hogenakkal Water Supply and Fluorosis Mitigation Project in Krishnagiri & Dharmapuri district**

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
06.05.2026	TENKASI	DINAMALAR	Newly laid road turns into potholes due to pipe burst; motorists fear accidents



Damaged 63 mm PVC was rectified and water supply effected on 06.05.2026 under **CWSS to Shencottai Municipality 4TP's and 47 wayside Habitations in Tenkasi district**

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
07.05.2026	POLLACHI	Dinakaran	Water wasted due to damaged pipeline by setting fire to dry bushes ; people in distress



140mm PVC pipe line leak was rectified on 6.05.2026 under CWSS to Suleeswaranpatti, in Coimbatore district

Latitude: 10.692095
 Longitude: 77.048137
 Elevation: 322.66±4.34 m
 Accuracy: 18.69 m
 Time: 06-05-2026 13:12
 Note: வடுகபாளையம் தொகுப்பு (வடுகிலி சி.என். 75)

Action taken on the Water supply issues reported


Date	District	Name of the Newspaper	Issues published
07.05.2026	POLLACHI	Dinamalar	Machine hole damaged ; Risk of road accidents



Damaged machine hole cover at Pollachi –Palladam road (Mahalingam junction) was replaced on 6.5.2026 for Pollachi UGSS in Coimbatore district

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
08.05.2026	NAGAPATTINAM	HINDU TAMZHH	Kollidam water pipe damaged in 5 places, raising the risk of water scarcity

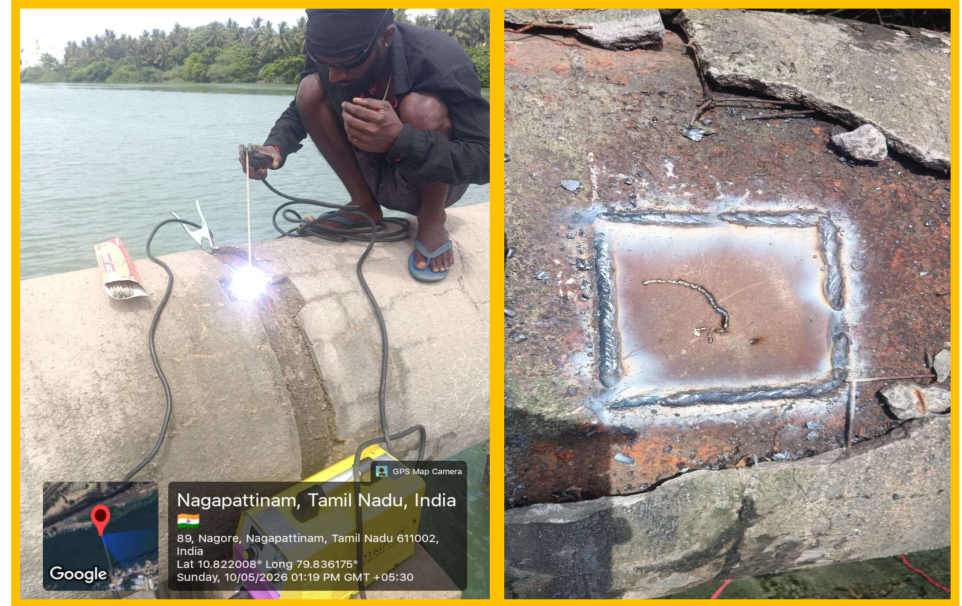

700mm PSC pipe line leaks were rectified and water supply effected on 10.05.2026 under **Nagapattinam CWSS** in **Nagapattinam district**

Action taken on the Water supply issues reported


Date	District	Name of the Newspaper	Issues published
09.05.2026	THENI	DHINAMALAR	Drinking water wasted due to a broken pipe.



300 mm AC pipeline leak was rectified and water supply effected on 12.05.2026 under **CWSS to palakombai & 48 other habitation in Theni district.**

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
09.05.2026	THIRUVARUR	DINAKARAN	The drinking water shortage must be resolved

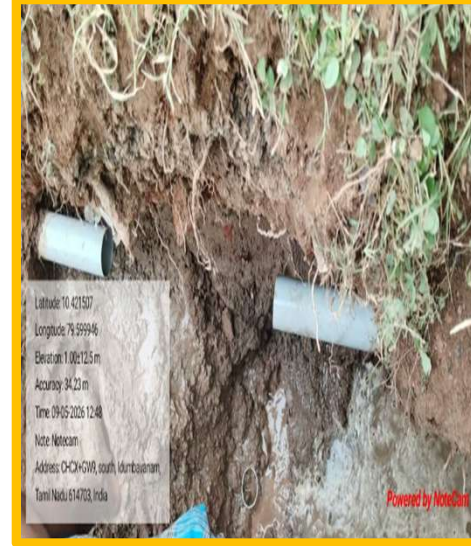


90mm PVC pipe line leak was rectified and water supply effected on 09.05.2026 under CWSS to vedaranyam in Thiruvavarur district.

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
10.05.2026	Dindigul	DINA THANTHI	Drinking water wasted due to a broken pipe

குழாய் உடைந்து வீணாகும் குடிநீர்
 ளரியோடு, மே.10-
 ளரியோட்டில், கோவிலூர் செல்லும் சாலையில் காவிரிக்
 கூட்டு குடிநீர் குழாய் செல்கிறது. இந்த குழாயில் நேற்று
 திடீரென உடைப்பு ஏற்பட்டு, குடிநீர் சாலையில் வீணாக
 ஓடியது. இதே குழாயில் அடிக்கடி உடைப்பு ஏற்பட்டு, குடிநீர்
 வீணாகி வருவதால், அந்த வழியாக செல்லும் திண்டிக்குல்-
 கரூர் சாலை சேதமடைந்து குண்டும், குழியுமாக மாறியுள்ளது.
 வீணாகும் குடிநீர் சாலையில் உள்ள பள்ளத்தில் தேங்கியுள்
 ளது. இதனால் சாலையில் பள்ளங்கள் இருப்பது தெரியாமல்
 வாகன ஓட்டிகள் விபத்தில் சிக்கி வருகின்றனர். எனவே
 குழாய் உடைப்பை சரிசெய்து, குடிநீர் வீணாவதை தடுக்க
 வேண்டும். அத்துடன் சேதமடைந்த சாலையை சீரமைக்க
 வேண்டும் என்று பொதுமக்கள் கோரிக்கை விடுத்துள்ளனர்.

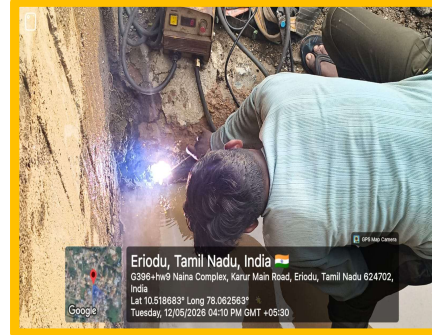

450mm PSC pipe line leak was rectified and water supply effected on 12.05.2026 under CWSS to Dindigul Corporation in 7 Town Panchayat & 636 Rural Habitation in Dindigul district.

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
10.05.2026	DHARMAPURI	DINAKARAN	Drinking water has been going to waste on the road for a month



500mm DI pipe line leak was rectified and water supply effected on 10.05.2026 under **Hogenakkal Water Supply and Fluorosis Mitigation Project** in Dharmapuri District.

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
14.05.2026	TENKASI	DINAMALAR	People are suffering due to damaged roads caused by breakage of drinking water pipe.



450mm PSC pipe line leak was rectified and water supply effected on 14.05.2026 under CWSS to Sengottai Municipality 4TP's and 47 wayside Habitations in Tenkasi district.

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
15.05.2026	Dindigul	HINDU TAMIZH	Drinking water was wasted due to damage of giant pipeline burst on the road



900mm PSC pipe line leak was rectified and water supply effected on 15.05.2026 under **Dindigul CWSS** in **Dindigul district**

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
16.05.2026	Namakkal	KALAIKATHIR	Frequently broken pipes cause drinking water to flow on the road



160 mm HDPE pipe line leak was rectified and water supply effected on 15.05.2026 under **CWSS to 547 Habitations in Namakkal district**

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
16.05.2026	TUTCORIN	DINATHANTHI	Water was wasted on the road due to a broken pipe



63 mm PVC pipe line leak was rectified and water supply effected on 17.05.2026 under 159 CWSS in Tutucorin district

Action taken on the Water supply issues reported


Date	District	Name of the Newspaper	Issues published
18.05.2026	SALEM	DINAKARAN	Drinking water was wasted due to the negligence of officials.



Leak occurred in 200mm Air valve along Avinashi to Tiruppur road was rectified and water supply effected on 17.05.2026 under CWSIS to Tiruppur Corporation, 15 Velampalayam and Nallur Municipalities, Annur, Avinashi and Thirumuranpoondi Town Panchayats and 362 Rural Habitations in Coimbatore and Tirupur Districts

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
18.05.2026	TIRUCHIRAPALLI	DINATHANTHI	Cauvery drinking water gushed 20 feet high due to a burst pipe

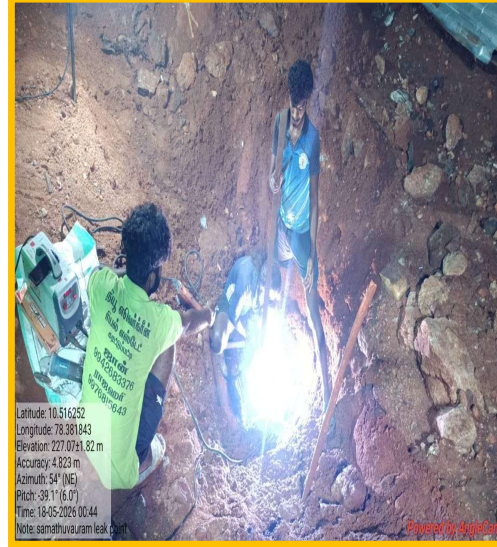

1100 mm MS pipe line leak was rectified and water supply effected on 18.05.2026 under Melur CWSS in Tiruchirapalli district

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
19.05.2026	KARUR	DINAKARAN	CWSS pipe broke; causing water wastage



700 mm PSC pipeline leak was rectified and water supply effected on 19.05.2026 under CWSS to 674 habitations in Manappari, Marungapuri Unions and Ponnampatty TP in Trichy District.

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
19.05.2026	TIRUVANNAMALAI	DINAKARAN	Water is being wasted due to a broken CWSS drinking water pipeline



140mm PVC pipe line leak was rectified and water supply effected on 19.05.2026 under CWSS to Chengam,Pudupalayam TPs and 40 wayside habitations in Chengam,Pudupalayam unions in Thiruvannamalai district

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
20.05.2026	THIRUVARUR	DINAKARAN	Due to a broken CWSS water pipe; Water is being wasted



1100 mm MS pipe line leak was rectified and water supply effected on 20.05.2026 under Vedaranyam CWSS in Thiruvavur district

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
20.05.2026	SIVAGANGAI	DINATHANTHI	Cauvery scheme pipe damaged near Cholapuram in Sivagangai



280mm HDPE pipe line leak rectification work is completed and water supply effected on 20 .05.2026 under **Sivagangai CWSS** in **Sivagangai district**

Action taken on the Water supply issues reported


Date	District	Name of the Newspaper	Issues published
20.05.2026	RAMANATHAPURAM	DINAMALAR	Water wasted due to broken pipe ; road damaged



200 mm OPVC pipe line leak was rectified and water supply effected on 19.05.2026 under **RAMNAD CWSS in Ramanathapuram district**


Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
21.05.2026	PUDUKOTTAI	DINATHANTHI	Water being wasted due to damaged pipe

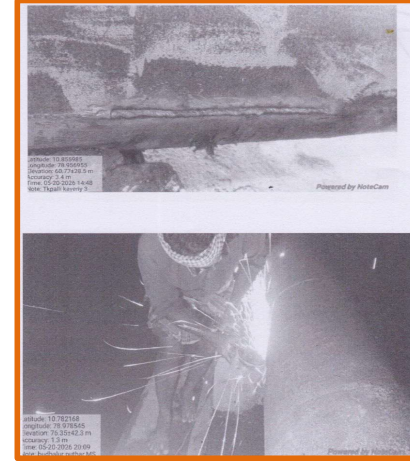

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
22.05.2026	COIMBATORE	DINATHANTHI	Sewage water overflowing through a machinehole

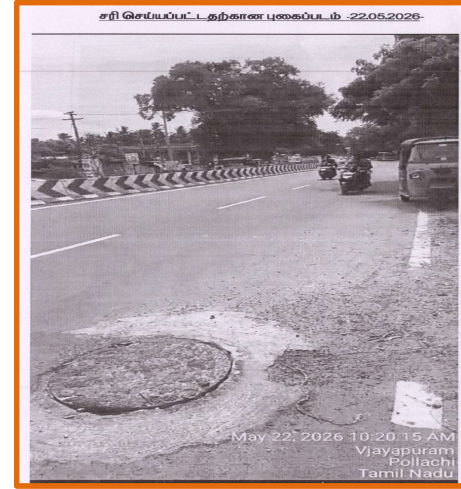

Blockage in machine hole was removed on 22.05.2026 under Pollachi UGSS in Coimbatore district